

The Renson Healthconnector is used to ensure the air quality is good in schools, offices, and industrial buildings.

## SCOPE OF APPLICATION

- It is a suitable solution for integrating demand-driven ventilation in buildings. Demand-driven ventilation provides energy-efficient ventilation while maintaining good air quality and comfort.
- To be used in buildings with a central ventilation system, both in new construction and renovation projects.
  - Extraction [system type C]:
    - Supply of fresh air using window ventilation.
    - Air extraction using central constant pressure ventilator[s].
  - In combination with heat-recovery system [system type D]:
    - Supply and extraction of air using central constant pressure ventilator[s]
- Individual control of ventilation per room.
- Plug and Play principle: Healthconnector can be directly integrated into the air duct network.
- The Healthconnector with CO<sub>2</sub> detector is included in the best air conditioning class IDA-C6 of the European ventilation standard for non-residential buildings [NBN EN 13779:2007].



## VERSIONS

There are 19 different types of the Healthconnector as determined by:

- The sensors [RH, CO<sub>2</sub>, IAQ]
- The diameter [Ø125, Ø200, Ø250]
- Manner in which it is connected to a building management system [0-10V, Modbus]
- With or without sound damper [Ø125]

|        | Ø   | Sensor |      |                 | Connection to building management system | Article number |
|--------|-----|--------|------|-----------------|------------------------------------------|----------------|
|        |     | RH*    | IAQ* | CO <sub>2</sub> |                                          |                |
| Master | 125 | –      | –    | •               | 0-10 V [with sound damper]               | 66026000       |
|        | 125 | •      | •    | –               | 0-10 V [with sound damper]               | 66026001       |
|        | 125 | –      | –    | •               | Modbus <sup>®</sup> [with sound damper]  | 66026002       |
|        | 125 | •      | •    | –               | Modbus <sup>®</sup> [with sound damper]  | 66026003       |
|        | 125 | •      | –    | •               | 0-10 V [with sound damper]               | 66026098       |
|        | 125 | •      | –    | •               | 0-10 V [without sound damper]            | 66026099       |
|        | 125 | –      | –    | •               | 0-10 V [without sound damper]            | 66026100       |
|        | 125 | •      | •    | –               | 0-10 V [without sound damper]            | 66026101       |
|        | 200 | –      | –    | •               | 0-10 V                                   | 66026004       |
|        | 200 | •      | •    | –               | 0-10 V                                   | 66026005       |
|        | 200 | –      | –    | •               | Modbus <sup>®</sup>                      | 66026006       |
|        | 200 | •      | •    | –               | Modbus <sup>®</sup>                      | 66026007       |
|        | 250 | –      | –    | •               | 0-10 V                                   | 66026008       |
|        | 250 | •      | •    | –               | 0-10 V                                   | 66026009       |
| Slave  | 125 | –      | –    | –               | –                                        | 66026012       |
|        | 200 | –      | –    | –               | –                                        | 66026013       |
|        | 250 | –      | –    | –               | –                                        | 66026014       |
|        | 250 | –      | –    | •               | Modbus <sup>®</sup>                      | 66026010       |
|        | 250 | •      | •    | –               | Modbus <sup>®</sup>                      | 66026011       |

\* RH: Relative Humidity  
IAQ: Indoor Air Quality [odours, Volatile Organic Compounds – VOCs]

• present  
– not present

## PRIMARY FEATURES

### Master Healthconnector<sup>®</sup>

- The sensors continuously measure the indoor air quality IN the extraction airflow.
- The stepper motor automatically positions the internal valve blade based on the measured air quality (CO<sub>2</sub>, relative humidity and/or Indoor Air Quality). This regulates the extraction airflow depending on the indoor air quality.
- The Healthconnector CO<sub>2</sub> limit value is adjustable. The specified limit value ensures that the CO<sub>2</sub> level will not be exceeded in the connected room[s].
- Option to (temporarily) manual adjust the ventilation extraction airflow using the (optional) control or via the building management system.
- As standard, the Master Healthconnector is equipped to control a Slave Healthconnector and/or a motorised inlet louvre (if applicable).


### Slave Healthconnector<sup>®</sup>

- The Slave Healthconnector is a slave valve without integrated sensors that is controlled by the Master Healthconnector.
- The positioning of the valve blade is determined by the Master Healthconnector.
- The Slave Healthconnector can be powered separately or be supplied by the Master. The Plug and Play concept allows up to 6 slave valves to be supplied with power by 1 Master valve.

### Master Healthconnector<sup>®</sup> and Slave Healthconnector<sup>®</sup> set up

If a large ventilation extraction airflow (600+ m<sup>3</sup>/h) is required at the same location, the parallel Master-Slave combination can be used. The total extraction airflow is the sum of the individual Healthconnector airflows. Different types of Healthconnectors can be used together.

**HEALTHCONNECTOR<sup>®</sup> PARTS**

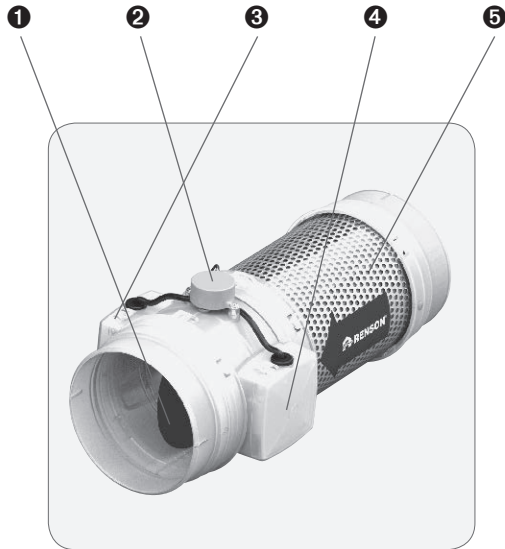

**Master**  
**Ø125**



**Master**  
**Ø200/250**

|                                              | Master                                                                                                                                                                                                                                                                                                                                                                                                       | Slave                 |
|----------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------|
| ❶ Valve blade                                | •                                                                                                                                                                                                                                                                                                                                                                                                            | •                     |
| ❷ Stepper motor                              | •                                                                                                                                                                                                                                                                                                                                                                                                            | •                     |
| ❸ Printed circuit board                      | •<br>[with RH and/or IAQ sensor]                                                                                                                                                                                                                                                                                                                                                                             | •<br>[without sensor] |
| ❹ CO <sub>2</sub> sensor                     | •<br>[if applicable]                                                                                                                                                                                                                                                                                                                                                                                         | -                     |
| ❺ Sound damper                               | •<br>[only Ø125]                                                                                                                                                                                                                                                                                                                                                                                             | •<br>[only Ø125]      |
| Healthconnector Ø125                         | <ul style="list-style-type: none"> <li>The valve blade halves are made of polypropylene</li> <li>The valve blade is made of ABS</li> <li>The integrated sound damper is made of: <ul style="list-style-type: none"> <li>- A perforated plate of size 395 mm x 200 mm x 1 mm and provides 40% airflow</li> <li>- Sound damping foam of size 260 mm x 358 mm F0.5/N0.5, thickness 12 mm</li> </ul> </li> </ul> |                       |
| Healthconnector Ø200/250                     | <ul style="list-style-type: none"> <li>The valve blade halves are made of ABS</li> <li>The cover is made of polypropylene</li> <li>The valve blade and connecting flange are galvanised</li> </ul>                                                                                                                                                                                                           |                       |
| Healthconnector Ø125 integrated sound damper | 5.7 dB [i.e. the actual difference between the sound pressure level measured at the same place from the source with and without the damper under the same conditions]                                                                                                                                                                                                                                        |                       |

## TECHNICAL SPECIFICATIONS

| Type                 | Healthconnector 125                                                |       | Healthconnector 200                                                |       | Healthconnector 250                                                |       |
|----------------------|--------------------------------------------------------------------|-------|--------------------------------------------------------------------|-------|--------------------------------------------------------------------|-------|
|                      | Master                                                             | Slave | Master                                                             | Slave | Master                                                             | Slave |
| Connection diameter  | Ø125                                                               |       | Ø200                                                               |       | Ø250                                                               |       |
| Airflow [max.]       | 125 m <sup>3</sup> /h<br>[i.e. the maximum airspeed<br>of 2.8 m/s] |       | 400 m <sup>3</sup> /h<br>[i.e. the maximum airspeed<br>of 3.5 m/s] |       | 600 m <sup>3</sup> /h<br>[i.e. the maximum airspeed<br>of 3.5 m/s] |       |
| Sound damping        | •                                                                  | •     | -                                                                  | -     | -                                                                  | -     |
| Integrated sensor[s] | •                                                                  | -     | •                                                                  | -     | •                                                                  | -     |

| Controls                                                                                                               |                                                                                                                                                                                                                                                                                                           |
|------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Valve position control<br><i>(via the optional control or Modbus<sup>®</sup>)</i>                                      | <p><b>Nominal position:</b><br/>16 steps from completely open to minimum position</p> <p><b>Minimum position:</b><br/>From 10% to 100% of the nominal airflow</p>                                                                                                                                         |
| Control valve blade in normal operation                                                                                | From the minimum position to nominal valve position in 7 steps                                                                                                                                                                                                                                            |
| <b>Master Healthconnector<sup>®</sup> control</b>                                                                      |                                                                                                                                                                                                                                                                                                           |
| CO <sub>2</sub> control                                                                                                | <p><b>Air extraction control:</b><br/>Linear control according to the specified CO<sub>2</sub> limit value.</p> <p><b>Opening the valve blade:</b><br/>Proportionately in 7 steps based on the measured and specified CO<sub>2</sub> limit value from minimum position to the nominal valve position.</p> |
| Master Healthconnector CO <sub>2</sub> limit value settings<br><i>(via the optional control or Modbus<sup>®</sup>)</i> | <ul style="list-style-type: none"> <li>- 600 ppm</li> <li>- 800 ppm</li> <li>- 900 ppm</li> <li>- 1000 ppm</li> <li>- 1100 ppm</li> <li>- 1200 ppm <i>(default)</i></li> <li>- 1400 ppm</li> <li>- 1600 ppm</li> </ul>                                                                                    |
| RH control                                                                                                             | <p><b>Air extraction control:</b><br/>Responds to a sudden increase or high absolute relative humidity value. The set values are fixed.</p> <p><b>Opening the valve blade:</b><br/>Opening from the minimum position to nominal valve position when moisture detected.</p>                                |
| IAQ control                                                                                                            | <p><b>Air extraction control:</b><br/>Responds to a sudden increase in or high absolute odour/VOCs value. The values are permanently set.</p> <p><b>Opening the valve blade:</b><br/>Opening from the minimum position to nominal valve position when odour detected.</p>                                 |
| <b>Slave Healthconnector control</b>                                                                                   | The Master Healthconnector uses a [wired] control signal to adjust the position of the Slave Healthconnector valve blade.                                                                                                                                                                                 |

| Power source connection voltage                     |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                             |
|-----------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| All types of Healthconnectors                       | <ul style="list-style-type: none"> <li>- 12 V/24 V DC</li> <li>- 12 V AC</li> </ul>                                                                                                                                                                                                                                                                                                                                                                                                                         |
| Power supply can be looped for each Healthconnector | 1 Master Healthconnector can power a maximum of 6 slaves                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
| Required amperage                                   | <ol style="list-style-type: none"> <li>1. Power for 1 Healthconnector: <math>I \geq 0.63</math> A</li> <li>2. If power looped: <ul style="list-style-type: none"> <li>• Power for 1 Master and 1 to 4 Slaves: <math>I \geq 1.26</math> A</li> <li>• Power for 1 Master and 5 to 6 Slaves: <ul style="list-style-type: none"> <li>- <math>I \geq 1.89</math> A, or,</li> <li>- <math>I \geq 1.26</math> A if the power supply can provide a peak voltage 1.89 A or higher</li> </ul> </li> </ul> </li> </ol> |

## OPTIONAL CONTROL

- RENSON 4-position switch with LED indicator:
  - During normal operation: the ventilation extraction airflow can be manually adjusted (only possible with the Master Healthconnector)
  - Adjustment: [temporarily] a minimum of a single 4-position switch is required to control the Healthconnector [both Master and Slave Healthconnector] unless the adjustment occurs via a Modbus building management system [only with the Master]
  - Display malfunctions
- Connection:
  - Use a 10-wire cable to connect to the Healthconnector (Min.  $10 \times 0.34$  mm<sup>2</sup>, Max.  $10 \times 0.8$  mm<sup>2</sup>)
  - A maximum of 2 controls can be connected (in parallel) to 1 Healthconnector
  - A maximum of 1 Healthconnector can be connected per control



## INSTALLATION

- When used according to system type C, the proper operation of the Healthconnector can only be guaranteed if the following two components are present and harmonised with each other:
  - Supply: Self-regulating ventilation louvres [P3 and P4].
  - Extraction: Constant pressure-controlled centralised ventilator.  
Set the ventilator pressure so that the pressure across the Healthconnector does not exceed 200 Pa.
- Multiple Healthconnectors can be connected using a central ventilator: Healthconnectors are installed in parallel.
- Installation:
  - Indoor environment [preferably within the insulated area].
  - In the air duct of the connected location[s].
  - The Healthconnector can be installed horizontally or vertically.
- Control [manual]: maximum opening limit
  - A control [optional] or Modbus building management system is required to start up the control.
  - Measure the airflow [using an anemometer] at the extraction louvre in the location. The Healthconnector nominal airflow must be adjusted using the control or Modbus<sup>®</sup> [i.e. determining the nominal position of the valve blade]. If necessary, additional fine-tuning can be made to the adjustable extraction louvre.

## COMPREHENSIVE APPLICATIONS

- Connection with inlet louvre with motorised inner valve  
The Healthconnector can be connected to Renson motorised inlet louvres (0-10 V signal). This allows the motorised inner valve in the inlet louvre to be controlled based on the indoor air quality.
- Connection with building management system:  
The Master Healthconnector can be connected to an [external] building management system via a Modbus<sup>®</sup> or via a 0-10 V voltage signal. For example, this allows the ventilation airflow to be controlled by the logic in the building management system.

### Modbus<sup>®</sup>

- Control and display the valve position [7 steps and valve blade completely closed]
- Control and display of HD and ECO ventilation modes
- control: setting the maximum and minimum valve position
- Display measured CO<sub>2</sub> value [in PPM] [if CO<sub>2</sub> sensor present]
- Set CO<sub>2</sub> threshold [if CO<sub>2</sub> sensor present]
- Feedback from the Healthconnector in operation:
  - sensors
  - display malfunctions
  - valve blade position
  - control active yes/no for CO<sub>2</sub>, RH and/or IAQ

### 0-10 V voltage signal

- Valve position manual control [7 steps and valve blade completely closed]
- HDC ventilation mode control

**TECHNICAL DRAWINGS**

| Healthconnector | Ø125 | Ø200 | Ø250 |
|-----------------|------|------|------|
| Master          | (A)  | (C)  | (E)  |
| Slave           | (B)  | (D)  | (F)  |

